

01 May 2014

Standard Test Methods for Determining the Tensile and Shear Strengths of Screws, 2013 Edition

American Iron and Steel Institute

Follow this and additional works at: <https://scholarsmine.mst.edu/ccfss-aisi-spec>



Part of the [Structural Engineering Commons](#)

Recommended Citation

American Iron and Steel Institute, "Standard Test Methods for Determining the Tensile and Shear Strengths of Screws, 2013 Edition" (2014). *AISI-Specifications for the Design of Cold-Formed Steel Structural Members*. 178.

<https://scholarsmine.mst.edu/ccfss-aisi-spec/178>

This Technical Report is brought to you for free and open access by Scholars' Mine. It has been accepted for inclusion in AISI-Specifications for the Design of Cold-Formed Steel Structural Members by an authorized administrator of Scholars' Mine. This work is protected by U. S. Copyright Law. Unauthorized use including reproduction for redistribution requires the permission of the copyright holder. For more information, please contact scholarsmine@mst.edu.



AISI S904-13



AISI STANDARD

Standard Test Methods for Determining the Tensile and Shear Strengths of Screws

2013 Edition

Approved by
the AISI Committee on Specifications for the Design of
Cold-Formed Steel Structural Members

The material contained herein has been developed by the American Iron and Steel Institute (AISI) Committee on Specifications for the Design of Cold-Formed Steel Structural Members. The organization and the Committee have made a diligent effort to present accurate, reliable, and useful information on testing of cold-formed steel members, components or structures. The Committee acknowledges and is grateful for the contributions of the numerous researchers, engineers, and others who have contributed to the body of knowledge on the subject. With anticipated improvements in understanding of the behavior of cold-formed steel and the continuing development of new technology, this material will become dated. It is anticipated that future editions of this test procedure will update this material as new information becomes available, but this cannot be guaranteed.

The materials set forth herein are for general information only. They are not a substitute for competent professional advice. Application of this information to a specific project should be reviewed by a registered professional engineer. Indeed, in most jurisdictions, such review is required by law. Anyone making use of the information set forth herein does so at their own risk and assumes any and all resulting liability arising therefrom.

1st Printing – May 2014

Produced by American Iron and Steel Institute

Copyright American Iron and Steel Institute 2014

PREFACE

The American Iron and Steel Institute Committee on Specifications developed this standard to provide test methods for determining the strength and deformation characteristics of mechanically fastened and welded connections for cold-formed steel building components.

The Committee acknowledges and is grateful for the contribution of the numerous engineers, researchers, producers and others who have contributed to the body of knowledge on this subject.

User Notes are non-mandatory and copyrightable portions of this standard.

This page is intentionally left blank.

AISI S904-13

Standard Test Methods for Determining the Tensile and Shear Strengths of Screws

1. Scope

1.1 These performance test methods establish procedures for conducting tests to determine the tensile and shear strength of carbon steel screws. The screws may be thread-forming or thread-cutting, with or without a self-drilling point, and with or without washers. The intended application for these screws is to connect cold-formed sheet steel material.

1.2 Two test methods are included in this Standard:

Tensile Test. This test is intended to determine the ability of a screw to withstand a load when applied along the axis of the screw.

Single Shear Test. This test is intended to determine the ability of a screw to withstand a load applied transversely to the axis of the screw.

1.3 These standard test methods describe mechanical tests for determining the following properties:

	Section
Tensile Strength	4.1
Single Shear Strength	4.2

1.4 These standard methods do not intend to address all of the safety concerns, if any, associated with their use. It is the responsibility of the user of these methods to establish appropriate safety and health practices, and to determine the applicability of regulatory limitations prior to use.

2. Referenced Documents

The following documents or portions thereof are referenced within this Standard and shall be considered as part of the requirements of this document.

a. American Iron and Steel Institute (AISI), Washington, DC:

S100-12, North American Specification for the Design of Cold-Formed Steel Structural Members

b. ASTM International (ASTM), West Conshohocken, PA:

A370-12a, Standard Test Methods and Definitions for Mechanical Testing of Steel Products

E6-09be1, Standard Terminology Relating to Methods of Mechanical Testing

F606-11a, Standard Test Methods for Determining the Mechanical Properties of Externally and Internally Threaded Fasteners, Washers, and Rivets

IEEE/ASTM-SI10-10, American National Standard for Metric Practice

3. Symbols

w = Test specimen width

L = Test specimen length excluding gripped end

e = Distance from center of the hole to the end of the specimen

p = Spacing of bolt holes

4. Test Methods

A test series shall be conducted for each screw material grade, head type, thread series and nominal diameter.

4.1 Tensile Test

4.1.1 The screw shall be tested in a holder with the load axially applied between the head and a suitable fixture, which shall have sufficient thread engagement to develop the full strength of the screw. See Figure 1 for a standard tensile test setup.

User Note:

Threads may be clamped directly by jaws of the testing machine if screw shank is not crushed.

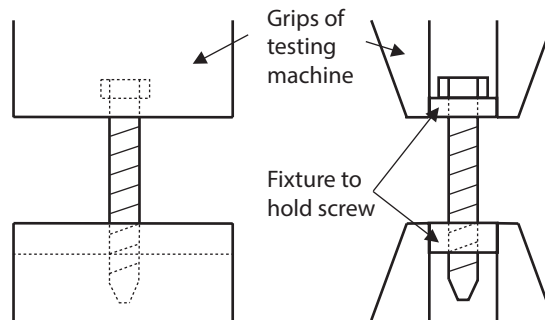


Figure 1 - Standard Tensile Test

4.1.2 The speed of testing, as determined by the rate of separation of the testing machine heads, shall be limited to the greater of 0.1 in. (2.5 mm) per minute or the separation rate caused by a loading rate of 500 pounds (2 kN) per minute.

4.1.3 The maximum load applied to the specimen, coincident with or prior to screw failure, shall be recorded as the tensile strength of the screw.


4.2 Single Shear Test

4.2.1 The specimen shall be tested using steel plates or shapes of sufficient thickness to preclude bearing failure and ensure failure through the fully threaded section. The shear plates or shapes shall create a single-lap joint connected with one or two fasteners. If two fasteners are used, the total shear strength of the connection shall be divided by two to determine the shear strength for one screw. Geometrical proportions of the test specimen shall be as suggested in Table 1, with reference to Figures 2 and 3. The test fixture shall provide for central loading across the lap joint. When the machine grips are adjustable, or when the thickness of either plate is less than 1/16 in. (2 mm), packing shims shall not be required for central loading.

Table 1 - Geometrical Proportions of Specimen

Screw Diameter, d in. (mm)	w in. (mm)	L in. (mm)	e in. (mm)	p in. (mm)
≤ 0.250 (6.5)	2 (50)	Min. 10 (250)	1 (25)	2 (50)
> 0.250 (6.5)	8d	Min. 10 (250)	3d > 1 (25)	3d > 2 (50)

4.2.2 The test specimen shall be permitted to be assembled in a shear fixture or threaded into two flat sheets. The test specimen shall be mounted in a tensile-testing machine capable of applying load at a controllable rate. The grips shall be self-aligning and care shall be taken when mounting the specimen to ensure that the load will be transmitted in a straight line transversely through the test screw(s). Load shall be applied and continued until failure of the screw(s). Speed of testing, as determined by the rate of separation of the testing machine heads, shall be limited to the greater of 0.1 in. (2.5 mm) per minute or the separation rate caused by a loading rate of 500 pounds (2 kN) per minute.

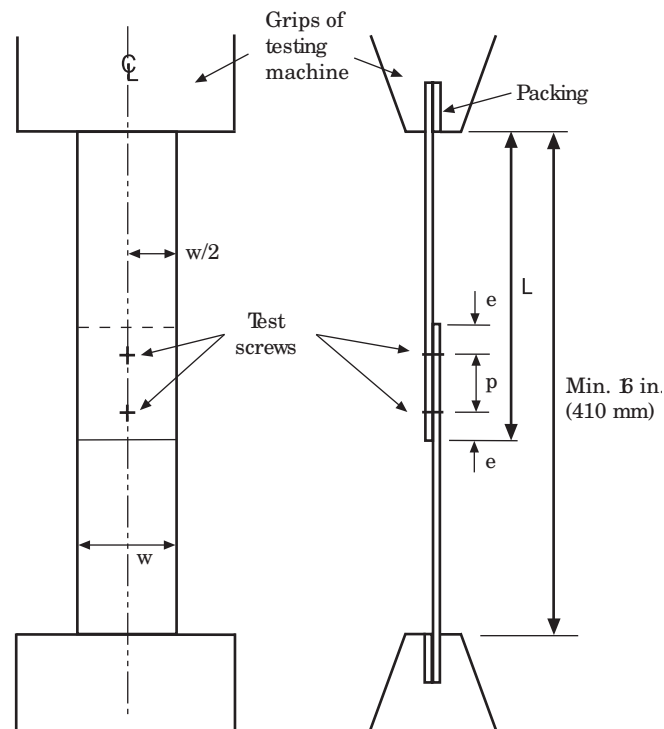**Figure 2 - Standard Lap-Joint Test - 2 Screws**

4.2.3 The maximum load applied to the specimen, coincident with or prior to screw failure, shall be recorded as the shear strength of the screw.

5. Report

5.1 The objectives and purposes of the test series shall be stated at the outset of the report so that the necessary test results, such as the maximum load per fastener and the mode of failure, are identified.

5.2 The types of tests, the testing organization, the supervising engineer, and the dates on which the tests were conducted shall be included in the documentation.

5.3 The test specimen shall be fully documented, including:

(a) The measured dimensions and identification data of each specimen:

- Thread O.D.
- Thread I.D.
- Threads per unit length
- Head dimensions
- Screw length
- Manufacturer
- Designation or type
- Unthreaded length or imperfect threads below head
- Grade of material
- Drill-point diameter and length of flutes for self-drilling screws
- Any other distinguishing characteristics

(b) The details of fastener installation including pre-drilling, diameter of the pilot drill if used, tightening torque, and any unique tools used in the installation, and

(c) Identification of the washers or washer-head data, including diameter, thickness, material, and data on the sealant if present.

5.4 The test setup shall be fully described, including the type of testing machine, the specimen end grips or supports.

5.5 The test procedure shall be fully documented, including the rate of loading.

5.6 In accordance with the test objectives stated by the responsible engineer, the report shall include a complete documentation of all applicable test results for each specimen such as the maximum load and the mode of failure. The report shall also include the necessary calculations for the screw design strength and safety factors/resistance factors based on the requirements specified in Section F1 of AISI S100.



25 Massachusetts Avenue NW
Suite 800
Washington, DC 20001
www.steel.org

